


INDIVIDUALLY ILLUMINATED PLEX FACE CHANNEL LETTERS



Scale: 3/4" = 1'-0"
Square footage: 19.75

BLUE

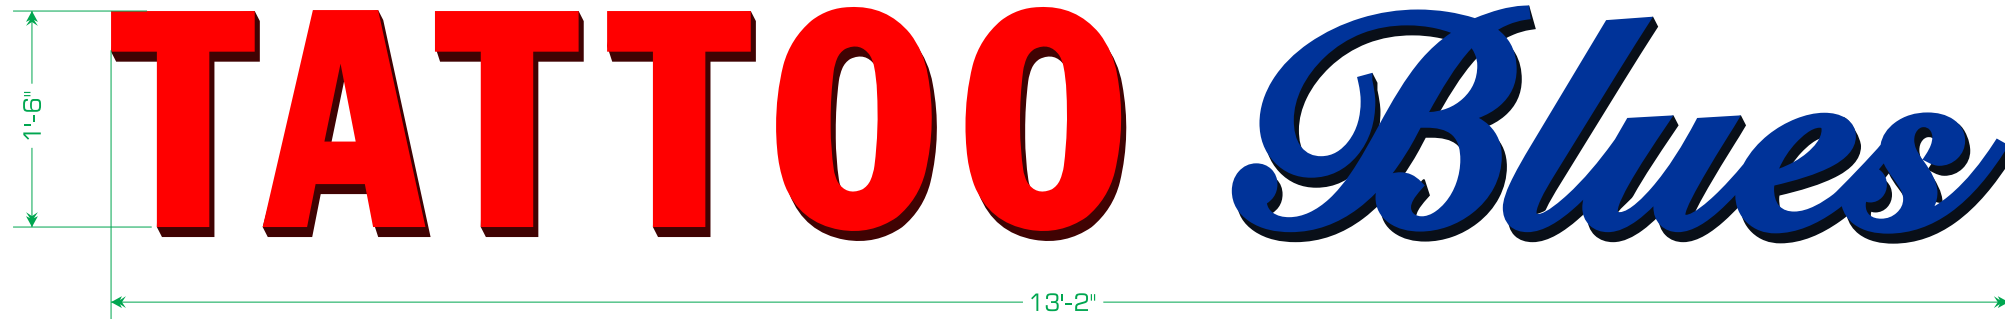

RED



Letter colors: Red, Blue
Letter Height: 18", 10"
Letter Return: To match faces.
Letter depth: 5"
Letter Style: Snell BD, Franklin
Raceway: n/a
Allowed Sq Ft:
Proposed Sq. Ft: 19.75
LEDs: White



CAM #16-1344
Exhibit 2
Page 1 of 4

COLORS SHOWN ON DRAWING ARE FOR PRESENTATION PURPOSES.
ALL COLORS MUST BE CONFIRMED AND INITIALED BY PROJECT MANAGER BEFORE PAINTING.

Scale: 3/16" = 1'-0"

Art SIGN COMPANY 835 NW 6th Ave. Ft. Lauderdale, FL. 33311
T. 954.763.4410 joe@artsignfl.com

CLIENT APPROVAL


TATTO BLUES

INDIVIDUALLY ILLUMINATED PLEX FACE CHANNEL LETTERS

Revisions:

SALES REP: JOE Drawn by: Carlos
DATE: 09/27/2016 Page: 1

Any party accepting this document does so in confidence and agrees that it should not be duplicated, in whole or in part, nor disclose to others, without the written consent of the client. Reference copy list for copy/graphic specific to each sign location. Contractor shall verify all conditions on site and notify any variation from what is shown on the drawings before proceeding with fabrication.

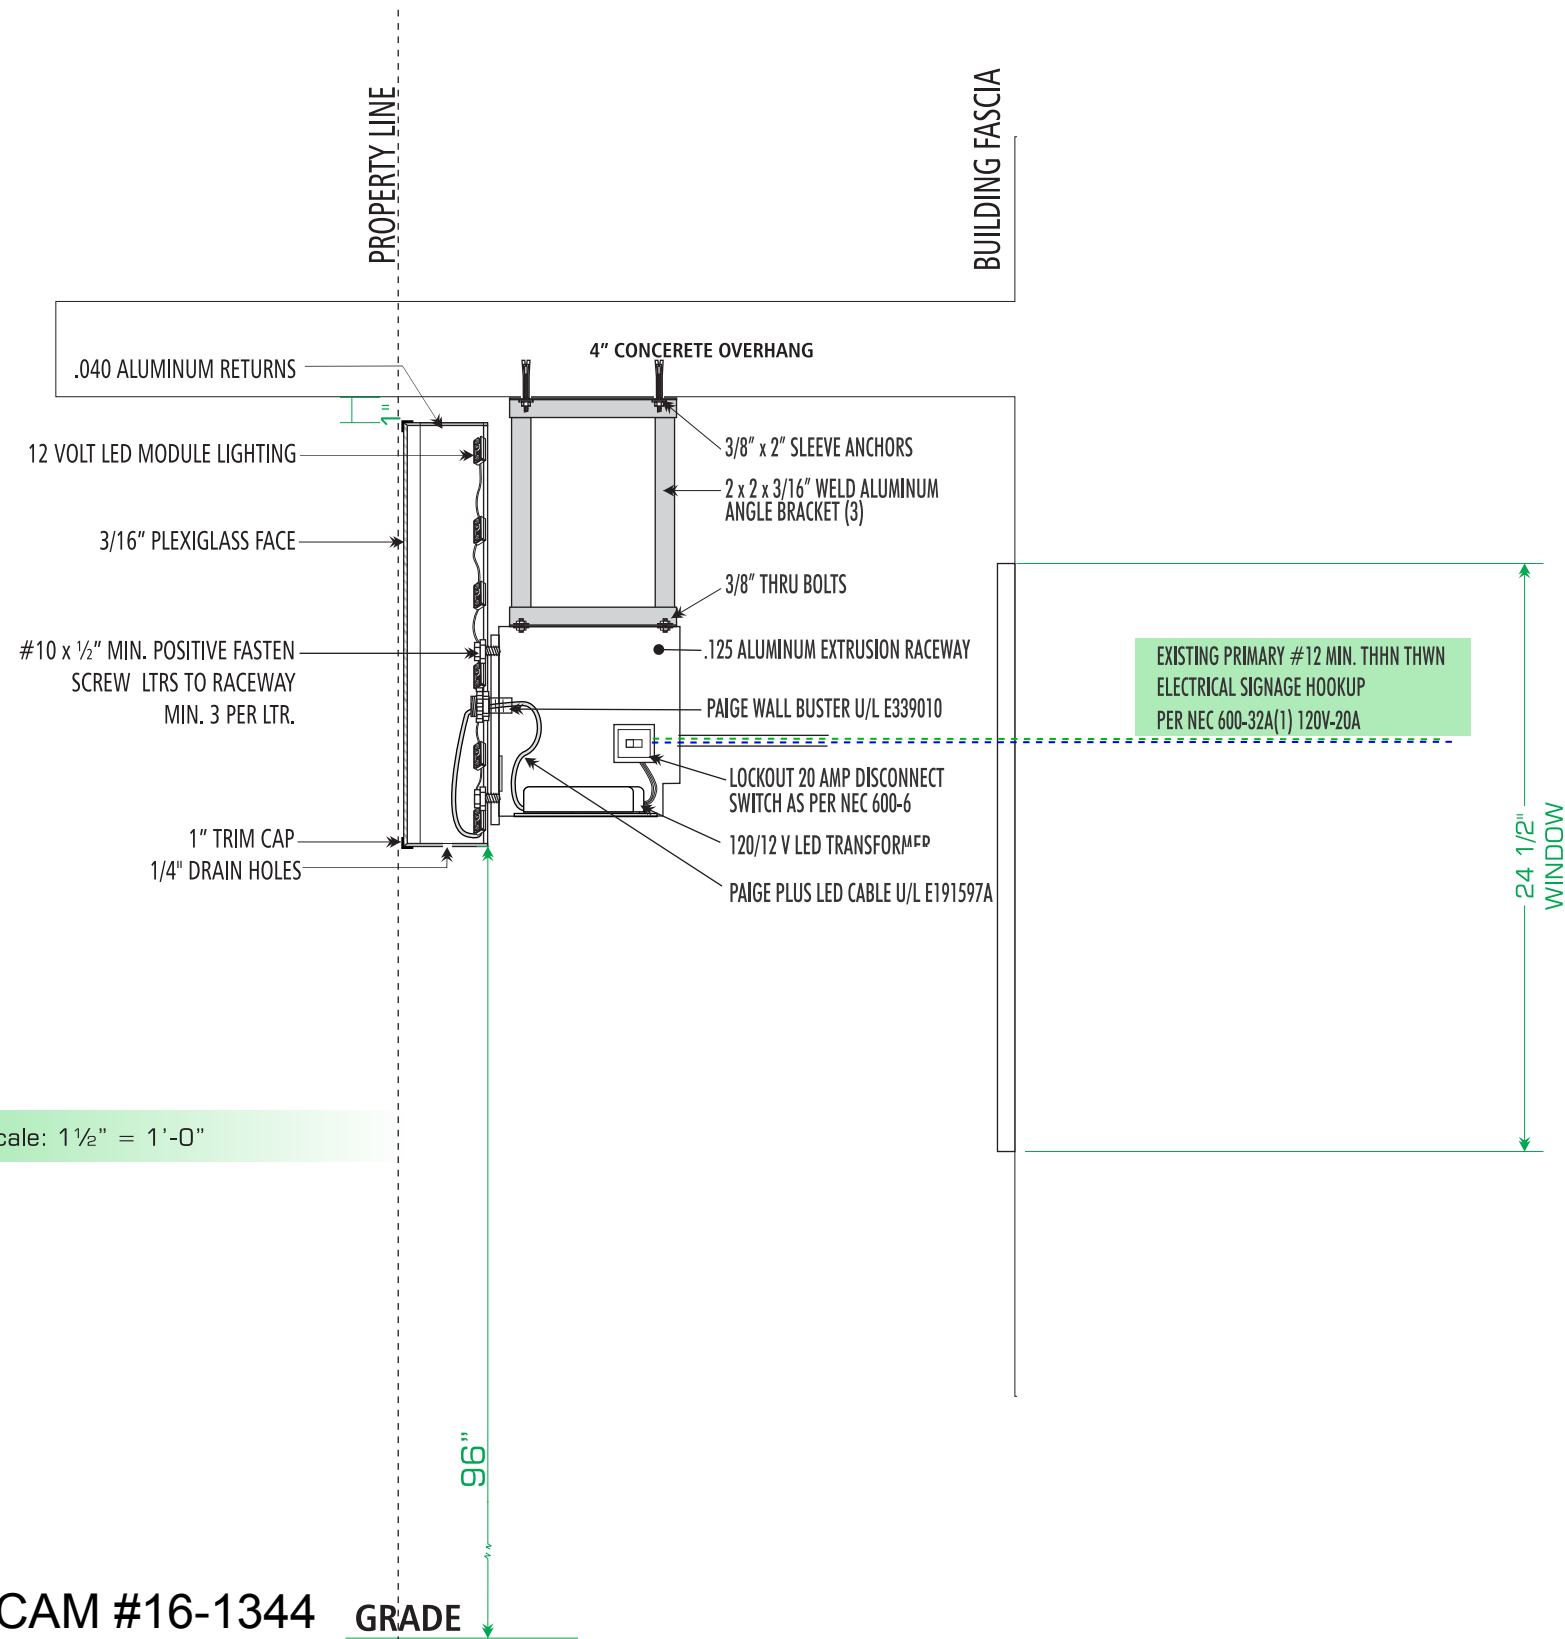

Scale: 1 1/2" = 1'-0"

CAM #16-1344
Exhibit 2
Page 2 of 4

ELECTRICAL SPECIFICATIONS:
 All electrical components are UL Listed
 Signage Grounding and Bonding as per NEC 250
 Primary wiring #12 THHN as per NEC 600-6
 Minimum 20 Amp. Disconnect Switch per NEC 240
 Minimum 1/2" conduit, time clock or photo cell per FEC
 All ballast electrical to have in-line fuses.



ENGINEER TONG LE P.E., INC.
 Consulting Structural Engineers
 5100 W Copans Rd. #700 Margate Fl.
 Tong Le President (954)974-6560

Broward & North Wall Sign

1. Design, fabrication and construction to the following codes and specifications:

- A. The Florida Building Code 5th edition (2014)
- B. American Welding Society AWS D1.1-04 & D1.2
- C. Specifications for aluminum structures by the Aluminum Association (Current Edition)

2. Structural requirements:

- A. All bolted connections shall be made with ASTM A307 bolt or equal
- B. All anchors bolts shall be ASTM A307 or equal (flat washers at nut)
- C. All welds shall be made with E70XX electrodes or equal
- D. The electrical installation shall be in compliance with the National Electric Code (NEC 2011) grounding and bonding as per NEC 250 600-7
- E. H.V.H.Z., section 1620 F.B.C., ASCE 7-10 170 MPH, exposure C, Category 2, Chapter 16

CIRCUITS REQUIREMENTS	
# OF CIRCUITS REQUIRE _____	TOTAL AMPS _____
# OF 20 APMS DISCONNECT SWITCHES _____	
BREAKER # _____	PANEL _____

QTY	SOURCE	SIZE	AMPS	TOTAL





splish
splash
bikini

NO
LEFT
TURN

VOLVO