



July 12, 2021

Courtney Crush
Crush Law Pa
333 S New River Dr E # 2200
Fort Lauderdale, FL 33301

Subject: **WATER AND WASTEWATER CAPACITY AVAILABILITY LETTER**
Olakino House – DRC Case No. UDP-S20009
551 Bayshore Drive, Fort Lauderdale, FL 33304

Dear Courtney Crush,

According to the information submitted, the project consists of developing an empty lot into an apartment building of 65 units with 1650 SF of resident dining space. There are proposed water and sewer connections to City of Fort Lauderdale (City) utilities along Bayshore Drive. This project lies within the City's Pump Station (PS) D-41 basin and will increase the average day water demand by 0.0130 million gallons per day (MGD) and the average day sewer demand by 0.0099 MGD. The existing water main does not have the capacity to support the proposed development. The existing sewer infrastructure has the capacity to support the proposed development.

If there are changes to the proposed development after issuance of this capacity availability letter, the Owner or Owner's authorized representative shall submit a revised request based on the updated plans. Failure to seek approval prior to changing the plans may result in revocation of permit and capacity allocation. The determination of capacity availability is based upon tools and data analysis as of the date of this letter. Availability of capacities, as calculated in the attached analysis, is not guaranteed and no existing system capacity shall be considered "committed" for this project until a permit has been issued and all fees have been paid. The City reserves the right to re-evaluate the availability of capacities at the time of permit application. If sufficient capacities are not available, the City may deny the permit application or ask the Owner/Developer to submit an alternate design prior to approval. Information contained in this letter will expire one year from the date issued.

Should you have any questions or require any additional information, please contact me at (954) 828-6982.

Sincerely,

Dronix Suarez, E.I.
Project Manager II

Enclosures: Water and Wastewater Capacity Analysis

cc: Raj Verma, P.E., Public Works Director
Talal Abi-Karam, P.E., Assistant Public Works Director
Omar Castellon, P.E., Chief Engineer
Dennis Girisgen, P.E., City Engineer
File: Water and Sewer Capacity Letters

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301
TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV

Equal Opportunity Employer

Printed On Recycled Paper





City of Fort Lauderdale
Public Works Department
Water and Wastewater Capacity Analysis

Olakino House – DRC Case No. UDP-S20009
551 Bayshore Drive, Fort Lauderdale, FL 33304

PROJECT AND DESCRIPTION

The project consists of developing an empty lot into an apartment building of 65 units with 1650 SF of resident dining space.

DESCRIPTION OF EXISTING UTILITIES

Water: The site is currently served by a 6-inch water main along Bayshore Drive, east of the project site. See Figure 1.

Wastewater: The site is currently served by an 8-inch gravity sewer main to the east of the project site along Bayshore drive. See Figure 2.

Pumping Station: The site is served by PS D-41 which is located at the intersection of Riomar Street and Bayshore Drive.

SUMMARY OF ANALYSIS AND REQUIRED ACTION

The existing water main does not have the capacity to support the proposed development. Starting at the intersection of Terramar Street and Bayshore Drive, 400 linear feet of 6-inch water main shall be upsized to a minimum of 10 inches in diameter. **See Figure 3.**

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301

TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV


Equal Opportunity Employer

Printed On Recycled Paper.





Figure 2 – City Sewer Atlas

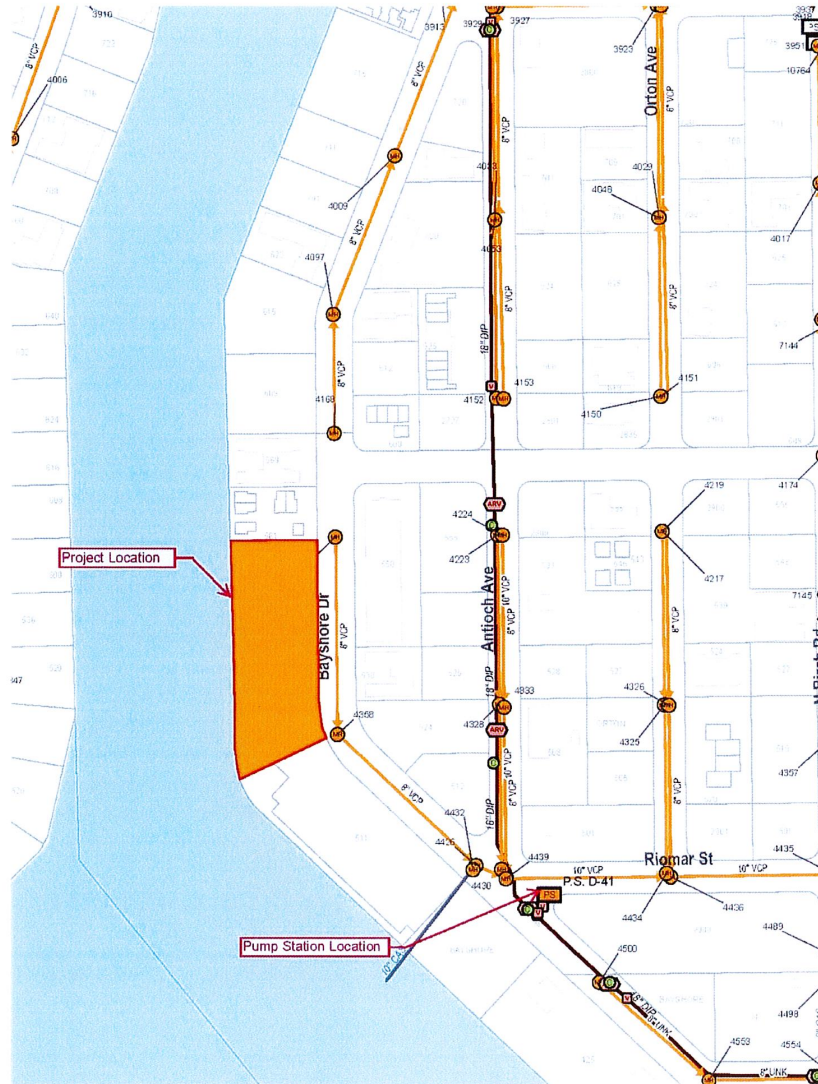

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301

TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV


Equal Opportunity Employer

Printed On Recycled Paper.





Figure 3 – Proposed Improvements

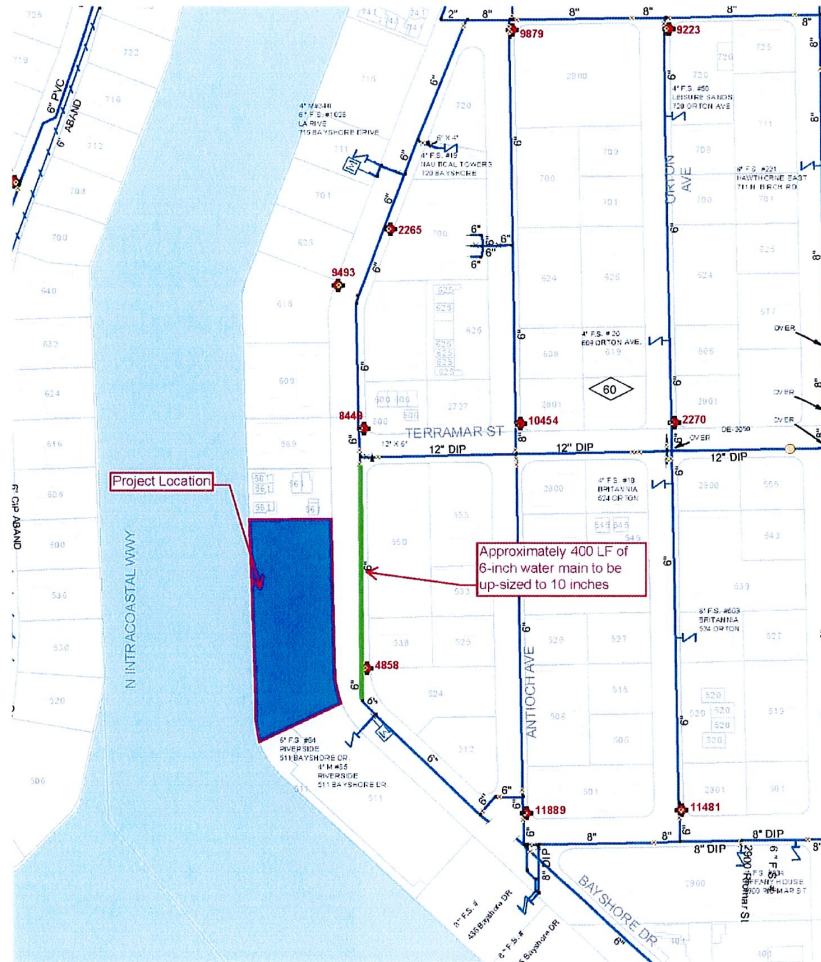

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301

TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV

Equal Opportunity Employer

Printed On Recycled Paper





WATER CAPACITY ANALYSIS

Requested Demand: Based on the applicant's site plan and building use information, the estimated average day potable water demand is approximately 13025 gallons per day (GPD), which equates to 0.0130 MGD. Average day water use demands are calculated by reducing the calculated max day water use demands by a factor of 1.3 as determined in the City's Comprehensive Utility Strategic Master Plan. The max day water use demands are calculated using the City's Guidelines for the Calculations of Sanitary Sewer Connection Fees and are based on City Ordinance No. C-19-29.

Evaluation of impact on existing distribution pipe (condition & capacity): According to the site plan, the applicant is proposing to utilize the 6-inch water main along Bayshore Drive. The InfoWater hydraulic model was analyzed to determine the impact of this project on the existing 6-inch water main.

Evaluation of impact of Permitted Water Plant Capacity: The Fiveash and the Peele Dixie Water Treatment Plants are designed to treat 70 MGD and 12 MGD of raw water respectively (82 MGD total). The total permitted Biscayne aquifer water withdrawals for these plants is limited to 52.55 MGD per the South Florida Water Management District (SFWMD) permit number 06-00123-W.

The current twelve-month rolling average production at the two plants is 37.67 MGD. The previously committed demand from development projects in the permitting or the construction stage is 4.78 MGD. Combining these figures with the demand from the proposed project of 0.0130 MGD, the required production would be 42.47 MGD. This is less than the allowable withdrawal limit of 52.55 MGD. Therefore, the water plants have sufficient capacity to serve this project. See Figure 4 below.

Recommended Water Infrastructure Improvements: The existing water main does not have the capacity to support the proposed development. Starting at the intersection of Terramar Street and Bayshore Drive, 400 linear feet of 6-inch water main shall be upsized to a minimum of 10 inches in diameter. **See Figure 3.**

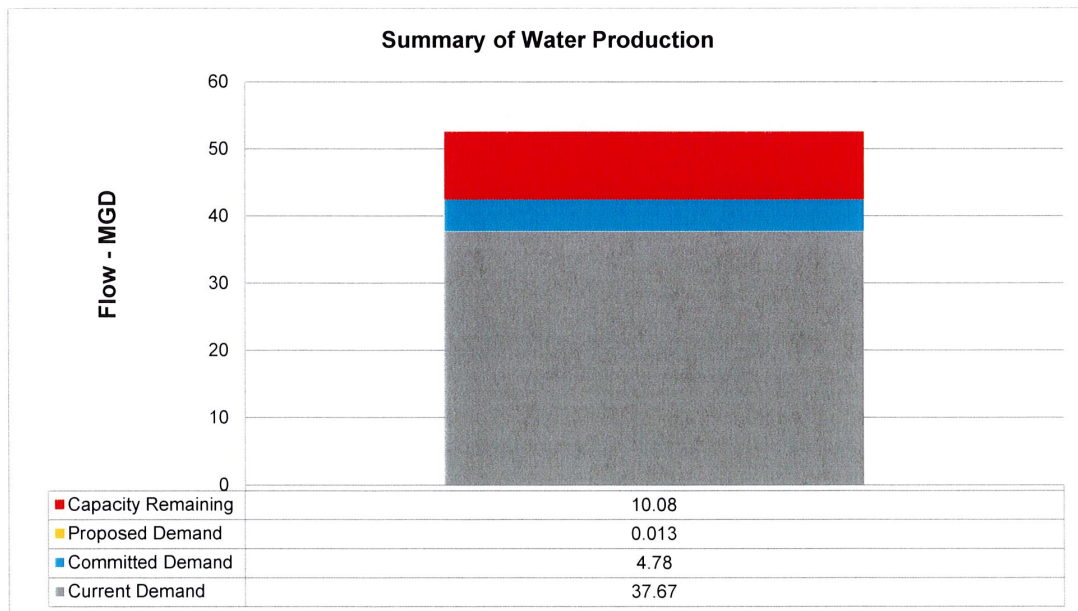


Figure 4

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301

TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV

Equal Opportunity Employer

Printed On Recycled Paper



WASTEWATER CAPACITY ANALYSIS

Requested Demand: Based on the applicant's site plan and building use information, the estimated average day sewer use demand is approximately 9877 GPD, which equates to 0.0099 MGD. Average day sewer use demands are calculated using the City's Guidelines for the Calculations of Sanitary Sewer Connection Fees and are based on City Ordinance No. C-19-29.

Evaluation of impact on existing collection pipe (condition and capacity): According to the site plan, the applicant is proposing to utilize the 8-inch gravity sewer main to the north of the project site along S.W. Bayshore Drive. Manual of Practice (MOP) 60, published by American Society of Civil Engineers (ASCE) for the gravity sewer design and used by the City staff, recommends that pipe diameters 15-inch or less be designed to flow half full during peak flows. The City uses a peak hourly flow factor of 3.0. Accounting for existing flows and based on the tools and information available to the City staff, it has been calculated that the pipes downstream of the proposed development will flow less than the ASCE-recommended 70% during peak flows. Therefore, the pipes downstream of the developments are adequate to serve the project.

Evaluation of impact on pumping station: PS D-41 has a duty point of 319 gallons per minute (GPM) and has a Nominal Average Pumping Operating Time (NAPOT) of approximately 21.57 hours per day. Based on projected sewage flows, the pumping run times would increase approximately 31 minutes per day. Additionally, there are other committed flows from proposed developments within the PS D-41 basin resulting in 244.41 minutes of additional runtime. PS D-41 will have a NAPOT of 26.16 hours once the proposed developments are complete. This is 2% of the overall time and therefore considered to be negligible. See Figure 5 below.

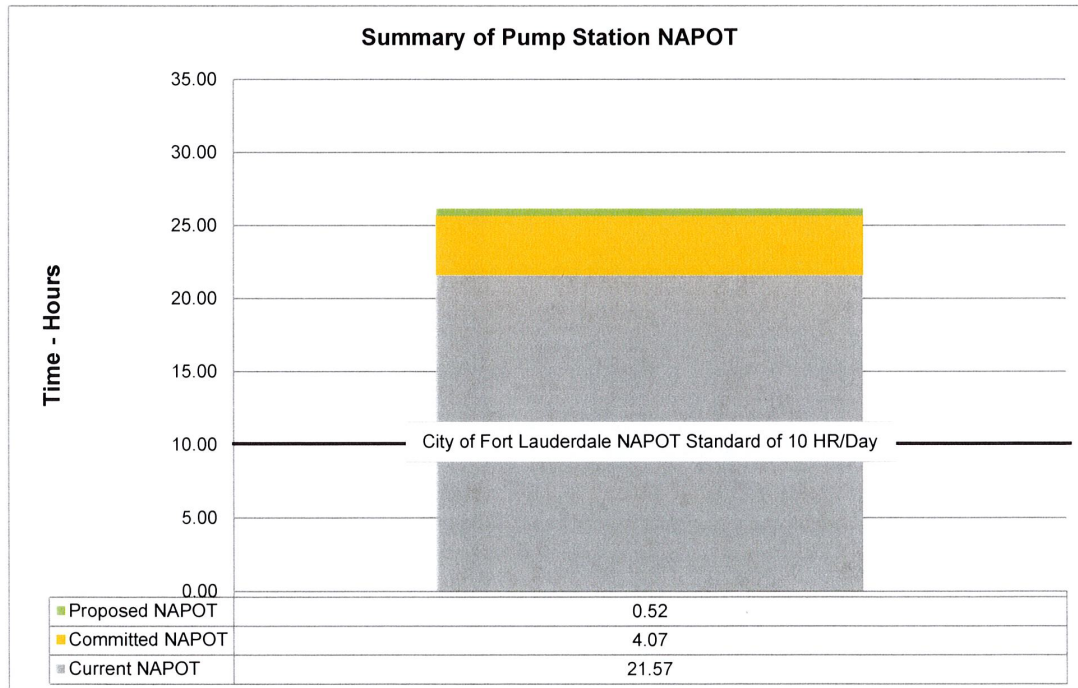


Figure 5

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301

TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV

Equal Opportunity Employer

Printed On Recycled Paper





Evaluation of impact of Permitted Wastewater Plant Capacity: The City of Fort Lauderdale owns and operates the George T. Lohmeyer Regional Wastewater Treatment Plant (GTL), which provides wastewater treatment for the City of Fort Lauderdale. The Broward County's Environmental Protection and Growth Management Department's (EPGMD) Environmental Licensing & Building Permitting Division's licensed capacity for GTL is 48 MGD-AADF (Million Gallons per Day – Annual Average Daily Flow). The annual average daily flow (AADF) to the plant is 41.87 MGD. Combining the committed flows for previously approved projects of 4.62 MGD plus the 0.0099 MGD net contribution from the project results in a total projected flow of 46.50 MGD. This is less than the permitted treatment plant capacity of 48 MGD. Therefore, the treatment plant has sufficient capacity to serve this project. See Figure 6 below.

Recommended Wastewater Infrastructure Improvements: No improvements required.

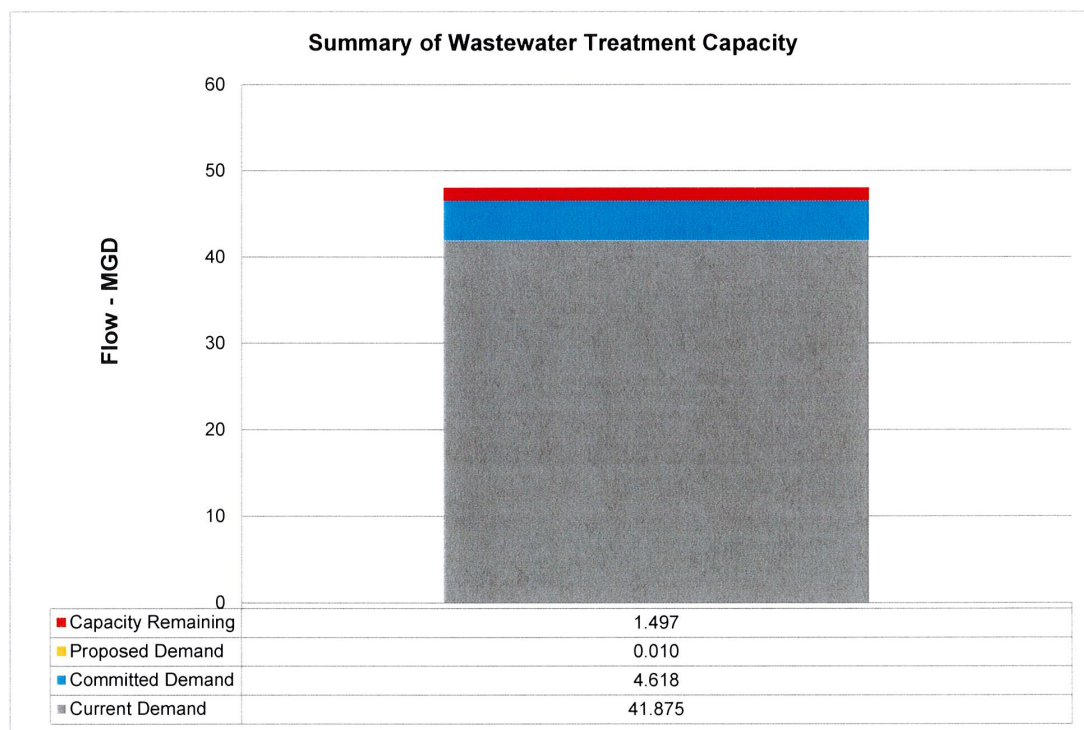


Figure 6

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301

TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV

Equal Opportunity Employer

Printed On Recycled Paper

