

PROJECT ADDRESS: 501 Seabreeze Blvd.

Date request was received:4/3/2025

DRC CASE#: UDP-S25010

Project Name: ISHOF - West Building

IF NO DRC CASE NUMBER PROVIDED, WATER & SEWER AVAILABILITY LETTER TO BE PROVIDED UPON PAYMENT OF ENCLOSED A/R INVOICE.

*******IMPORTANT INFORMATION*******

The following analysis is only VALID FOR A PERIOD OF ONE YEAR FROM THE DATE OF ISSUANCE. After which point, a reanalysis must be conducted to ensure adequate availability for projects.

- Water and Sanitary Sewer Capacity Allocation Letter (Small Project)\$1018
- Modifications to small project that require capacity re-analysis.....\$1018
- Water and Sanitary Sewer Capacity Allocation Letter (Large Project)\$2,544
- Modifications to large project that require capacity re-analysis.....\$2,544
- Revision.....\$0

August 27, 2025

Bhargava Nagaraju Professional Engineer, Associate
KEITH
301 E Atlantic Blvd
Pompano Beach, FL 33060

Subject: **WATER AND WASTEWATER CAPACITY AVAILABILITY LETTER**
ISHOF - West Building – DRC Case No. UDP-S25010
501 Seabreeze Blvd., Fort Lauderdale, FL 33316

Dear Bhargava Nagaraju,

According to the information submitted, the project consists of the addition of a museum building within the existing International Swimming Hall of Fame (ISHOF) campus. The building will consist of a total of six (6) floors, comprising a total of 203,068 SF. There are proposed water and sewer connections to City of Fort Lauderdale (City) utilities within the existing two-way drive aisle connecting to Seabreeze Boulevard. This project lies within the City's Pump Station (PS) D-31 basin and will increase the average day water demand by approximately 0.0256 million gallons per day (MGD) and the average day sewer demand by approximately 0.0176 MGD.

The determination of capacity availability is based upon an analysis of the City's water and sewer system models, average daily flows at the treatment plants, and previously committed flows, as of the date of this letter, in conjunction with the demand created by the proposed subject project. Availability of capacities, as calculated in the attached analysis, is not guaranteed and no existing system capacity shall be considered "reserved" for this project until development permit approval has been achieved and all fees have been paid. Once the development permit has been received for this project, the city shall reserve the necessary capacity to serve the development.

If there are changes to the proposed development after issuance of this capacity availability letter, and/or before development permit approval has been received, the Owner or Owner's authorized representative for the subject project must submit a revised request based on the updated plans.

If, at the time of building permit application, there are changes to the proposed development that require a new development permit or an amendment to an existing development permit which result in a change of the water and sewer demand, the City shall re-evaluate the availability of capacities and a new letter shall be obtained. If sufficient capacities for the increased demand are not available at that time, the City may deny the permit application or ask the Owner/Developer to submit an alternate design for consideration prior to approval. If a development permit is not approved within one year of this letter being issued, the information contained in this letter will expire and a new letter shall be required prior to development approval.

Should you have any questions or require any additional information, please contact me at (954) 828-6073.

Sincerely,



J.D. Fernandez
Project Manager II

Enclosures: Water and Wastewater Capacity Analysis

cc: Brad Kaine, Public Works Director
Talal Abi-Karam, P.E., Assistant Public Works Director-Utilities
Benjamin Restrepo, P.E., City Engineer
Orlando Arrom, Land Development Manager
File: Water and Sewer Capacity Letters

City of Fort Lauderdale
Public Works Department
Water and Wastewater Capacity Analysis

**ISHOF - West Building – DRC Case No. UDP-S25010
501 Seabreeze Blvd., Fort Lauderdale, FL 33316**

PROJECT AND DESCRIPTION

The project consists of the addition of a 203,068 SF museum building to the existing International Swimming Hall of Fame (ISHOF) campus.

DESCRIPTION OF EXISTING UTILITIES

Water: The site is currently served by a 12-inch water main along Seabreeze Blvd, east of the project site. See Figure 1.

Wastewater: The site is currently served by a 10-inch gravity sewer main to the east of the project site along Seabreeze Blvd. See Figure 2.

Pumping Station: The site is served by PS D-31 which is located along S. Birch Rd.

SUMMARY OF ANALYSIS AND REQUIRED ACTION

Based on this analysis, no system improvements are required at this time.

Figure 1 – City Water Atlas


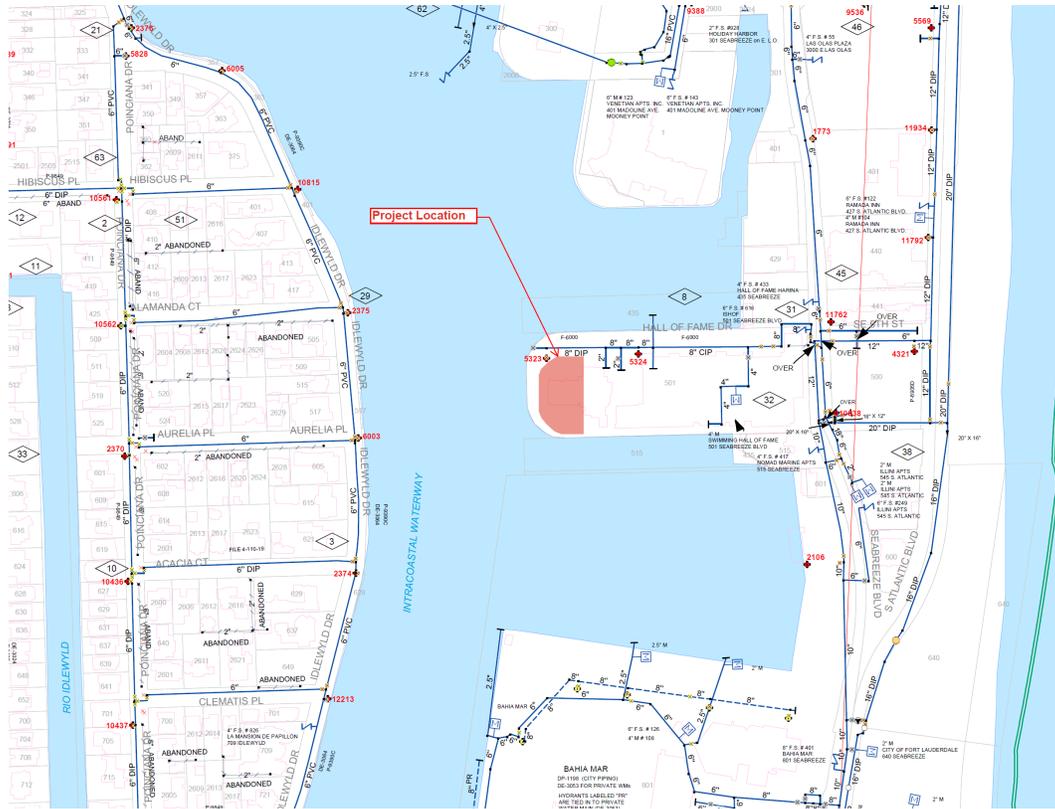


Figure 2 – City Sewer Atlas

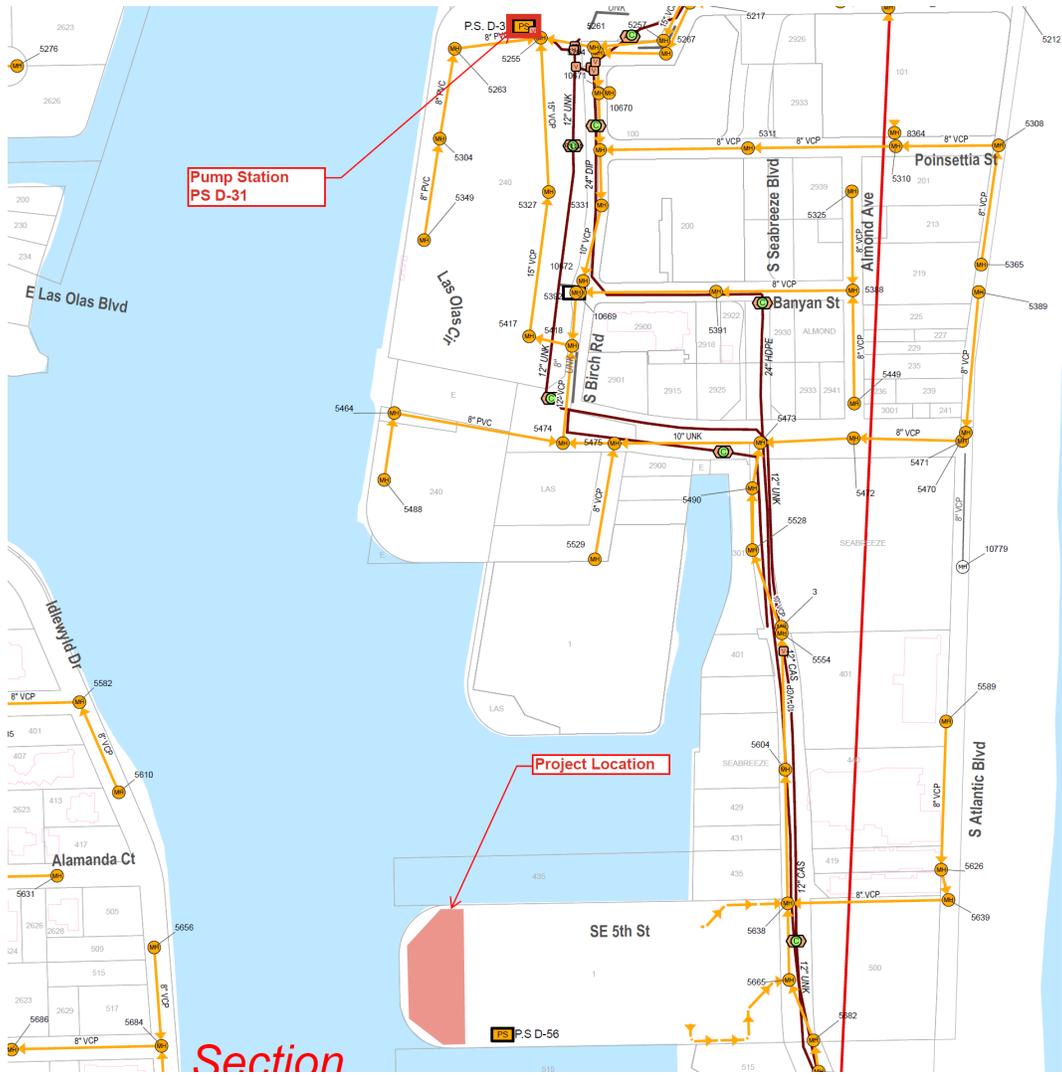

WATER CAPACITY ANALYSIS

Requested Demand: Based on the applicant’s site plan and building use information, the estimated average day potable water demand is approximately 25622 gallons per day (GPD), which equates to 0.0256 MGD. Average day water use demands are calculated by reducing the calculated max day water use demands by a factor of 1.18. The max day water use demands are calculated using the City’s Guidelines for the Calculations of Sanitary Sewer Connection Fees and are based on City Ordinance No. C-19-29.

Evaluation of impact on existing distribution pipe: According to the site plan, the applicant is proposing to utilize the 12-inch water main located along Seabreeze Blvd. The InfoWater hydraulic model was analyzed to determine the impact of this project on the existing 12-inch water main.

Evaluation of impact of Permitted Water Plant Capacity: The Fiveash and the Peele Dixie Water Treatment Plants are designed to treat 70 MGD and 12 MGD of raw water respectively (82 MGD total). The total permitted Biscayne aquifer water withdrawals for these plants is limited to 52.55 MGD per the South Florida Water Management District (SFWMD) permit number 06-00123-W.

The current twelve-month rolling average production at the two plants is 38.26 MGD. The previously committed demand from development projects in the permitting or the construction stage is 5.73 MGD. Combining these figures with the demand from the proposed project of 0.0256 MGD, the required production would be 44.02 MGD. This is less than the allowable withdrawal limit of 52.55 MGD. Therefore, the water plants have sufficient capacity to serve this project. See Figure 3 below.

Recommended Water Infrastructure Improvements: No improvements required.

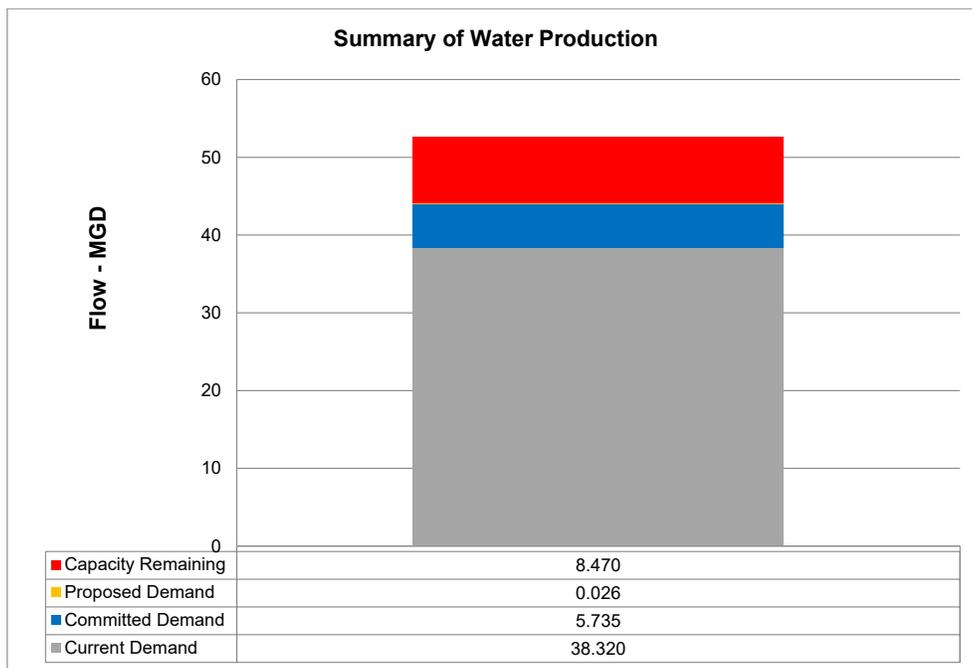


Figure 3

WASTEWATER CAPACITY ANALYSIS

Requested Demand: Based on the applicant's site plan and building use information, the estimated average day sewer use demand is approximately 17637 GPD, which equates to 0.0176 MGD. Average day sewer use demands are calculated using the City's Guidelines for the Calculations of Sanitary Sewer Connection Fees and are based on City Ordinance No. C-19-29.

Evaluation of impact on existing collection pipe: According to the site plan, the applicant is proposing to utilize the existing 10-inch gravity sewer main to the east of the project site along Seabreeze Blvd. Accounting for existing flows and based on the tools and information available to the City staff, it has been calculated that the pipes downstream of the proposed development will flow less than the City's governance plan threshold of 70% during peak flows. Therefore, the pipes downstream of the developments are adequate to serve the proposed project.

Evaluation of impact on pumping station: PS D-31 has a duty point of 1600 gallons per minute (GPM) and has a Nominal Average Pumping Operating Time (NAPOT) of approximately 3.97 hours per day. Based on projected sewage flows, the pumping run times would increase approximately 11 minutes per day. Additionally, there are other committed flows from proposed developments within the PS D-31 basin resulting in 0.00 minutes of additional runtime. PS D-31 will have a NAPOT of 4.16 hours once the proposed developments are complete, less than the recommended average of 10 hours per day. See Figure 4 below.

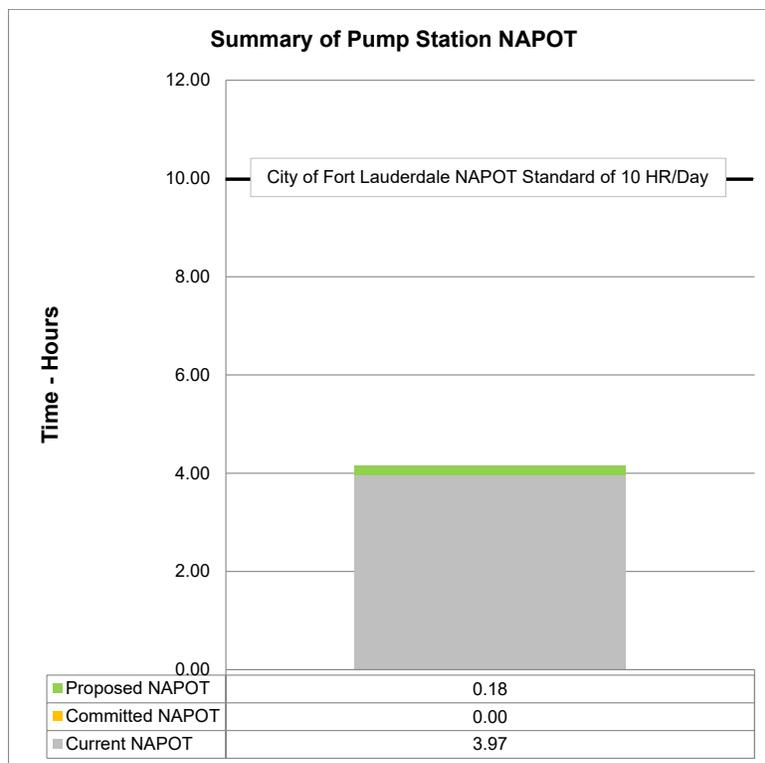


Figure 4

Evaluation of impact of Permitted Wastewater Plant Capacity: The City of Fort Lauderdale owns and operates the George T. Lohmeyer Regional Wastewater Treatment Plant (GTL), which provides wastewater treatment for the City of Fort Lauderdale. The Florida Department of Environmental Protection's (FDEP) permitted capacity for GTL is 56.6 MGD-TMADF (Million Gallons per Day – Three Month Average Daily Flow). The three-month average daily flow (TMADF) to the plant is 38.89 MGD. Combining the committed flows for previously approved projects of 4.50 MGD plus the 0.0176 MGD net contribution from the project results in a total projected flow of 43.41 MGD. This is less than the permitted treatment plant capacity of 56.6 MGD. Therefore, the treatment plant has sufficient capacity to serve this project. See Figure 5 below.

Recommended Wastewater Infrastructure Improvements: No improvements required.

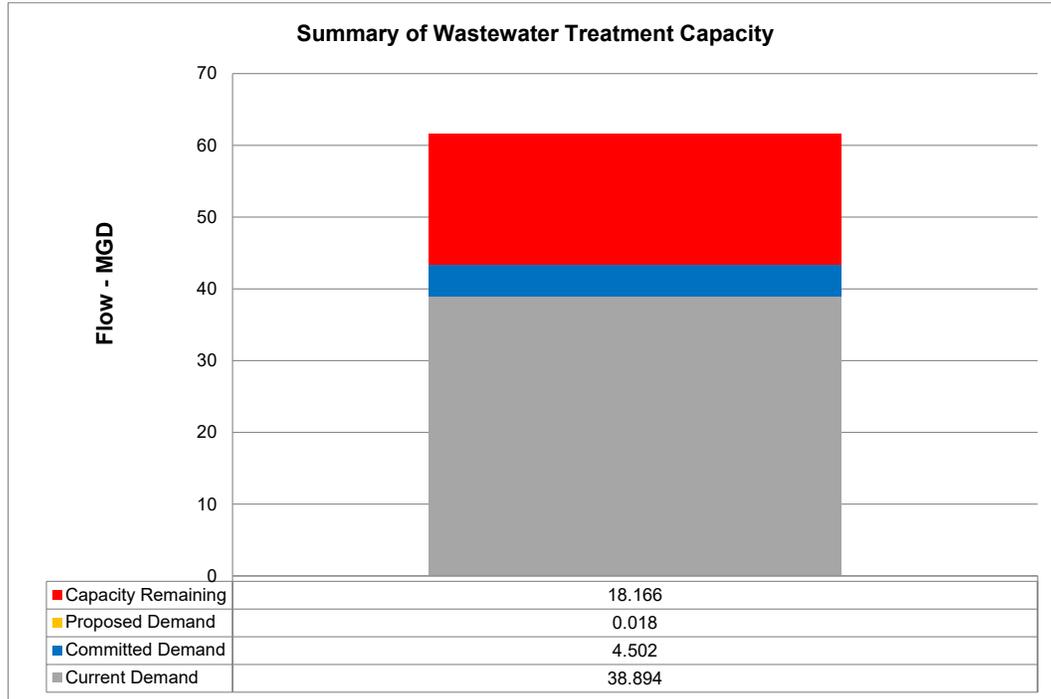


Figure 5