



PROJECT ADDRESS: 1117-1121 E Las Olas Boulevard

Date request was received:8/8/2025

DRC CASE#: UDP-SR25001

Project Name: Weston Jewelers Las Olas

IF NO DRC CASE NUMBER PROVIDED, WATER & SEWER AVAILABILITY LETTER TO BE PROVIDED UPON PAYMENT OF ENCLOSED A/R INVOICE.

****IMPORTANT INFORMATION****

The following analysis is only VALID FOR A PERIOD OF ONE YEAR FROM THE DATE OF ISSUANCE. After which point, a reanalysis must be conducted to ensure adequate availability for projects.

<input type="checkbox"/> Water and Sanitary Sewer Capacity Allocation Letter (Small Project)	\$1,018
<input type="checkbox"/> Modifications to small project that require capacity re-analysis	\$1,018
<input checked="" type="checkbox"/> Water and Sanitary Sewer Capacity Allocation Letter (Large Project)	\$2,544
<input type="checkbox"/> Modifications to large project that require capacity re-analysis	\$2,544
<input type="checkbox"/> Revisions	\$0

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301
TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV





September 22, 2025

Blake Kidwell
Four Ten Properties LLC
1728 Main Street
Weston, FL 33326

Subject: **WATER AND WASTEWATER CAPACITY AVAILABILITY LETTER**
Weston Jewelers Las Olas – DRC Case No. UDP-SR25001
1117-1121 E Las Olas Boulevard, Fort Lauderdale, FL 33311

Dear Blake Kidwell,

According to the information submitted, the project consists of the demolition of a 5-unit residential building and an office building of 2,769 square feet (SF), followed by the construction of a 5-story mixed-use building containing 24,291 SF of retail space, 6,912 SF of restaurant space and 8,163 SF of offices. There are proposed connections to City of Fort Lauderdale (City) utilities along SE 2 Court and SE 12 Ave. This project lies within the City's Pump Station (PS) A-9 basin and will increase the average day water demand by approximately 0.0076 million gallons per day (MGD) and the average day sewer demand by approximately 0.0053 MGD. The existing water and sewer infrastructure have the capacity to support the proposed development and no improvements are needed.

The determination of capacity availability is based upon an analysis of the City's water and sewer system models, average daily flows at the treatment plants, and previously committed flows, as of the date of this letter, in conjunction with the demand created by the proposed subject project. Availability of capacities, as calculated in the attached analysis, is not guaranteed and no existing system capacity shall be considered "reserved" for this project until development permit approval has been achieved and all fees have been paid. Once the development permit has been received for this project, the city shall reserve the necessary capacity to serve the development.

If there are changes to the proposed development after issuance of this capacity availability letter, and/or before development permit approval has been received, the Owner or Owner's authorized representative for the subject project must submit a revised request based on the updated plans.

If, at the time of building permit application, there are changes to the proposed development that require a new development permit or an amendment to an existing development permit which results in a change in water and sewer demand, the City shall re-evaluate the availability of capacities and a new letter shall be obtained. If sufficient capacities for the increased demand are not available at that time, the City may deny the permit application or ask the Owner/Developer to submit an alternate design for consideration prior to approval.

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301
TELEPHONE (954) 828-5772, FAX (954) 828-5074
WWW.FORTLAUDERDALE.GOV



If a development permit is not approved within one year of this letter being issued, the information contained in this letter will expire and a new letter shall be required prior to development approval.

Should you have any questions or require any additional information, please contact me at (954) 828-5115.

Sincerely,

Alejandra Simon
Project Manager II

Enclosures: Water and Wastewater Capacity Analysis

cc: Brad Kaine, Public Works Director
Talal Abi-Karam, P.E., Assistant Public Works Director-Utilities
Benjamin Restrepo, P.E., City Engineer
Orlando Arrom, Land Development Manager
File: Water and Sewer Capacity Letters

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301
TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV



City of Fort Lauderdale
Public Works Department
Water and Wastewater Capacity Analysis

Weston Jewelers Las Olas – DRC Case No. UDP-SR25001
1117-1121 E Las Olas Boulevard, Fort Lauderdale, FL 33311

PROJECT AND DESCRIPTION

The project consists of the demolition of a 5-unit residential building and an office building of 2,769 SF, followed by the construction of a 5-story mixed-use building containing 24,291 SF of retail space, 6,912 SF of restaurant space and 8,163 SF of offices.

DESCRIPTION OF EXISTING UTILITIES

Water: The site is currently served by an 8-inch water main along SE 2 Court, north of the project site as shown on Figure 1.

Wastewater: The site is currently served by an 8-inch gravity sewer main to the east of the project site along SE 12 Avenue as shown on Figure 2.

Pumping Station: The site is served by PS A-9 which is located along Tarpon Drive.

SUMMARY OF ANALYSIS AND REQUIRED ACTION

The existing infrastructure has the capacity to support the proposed development. Therefore, no improvements are needed.


PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301
TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV



Figure 1. City Water Atlas

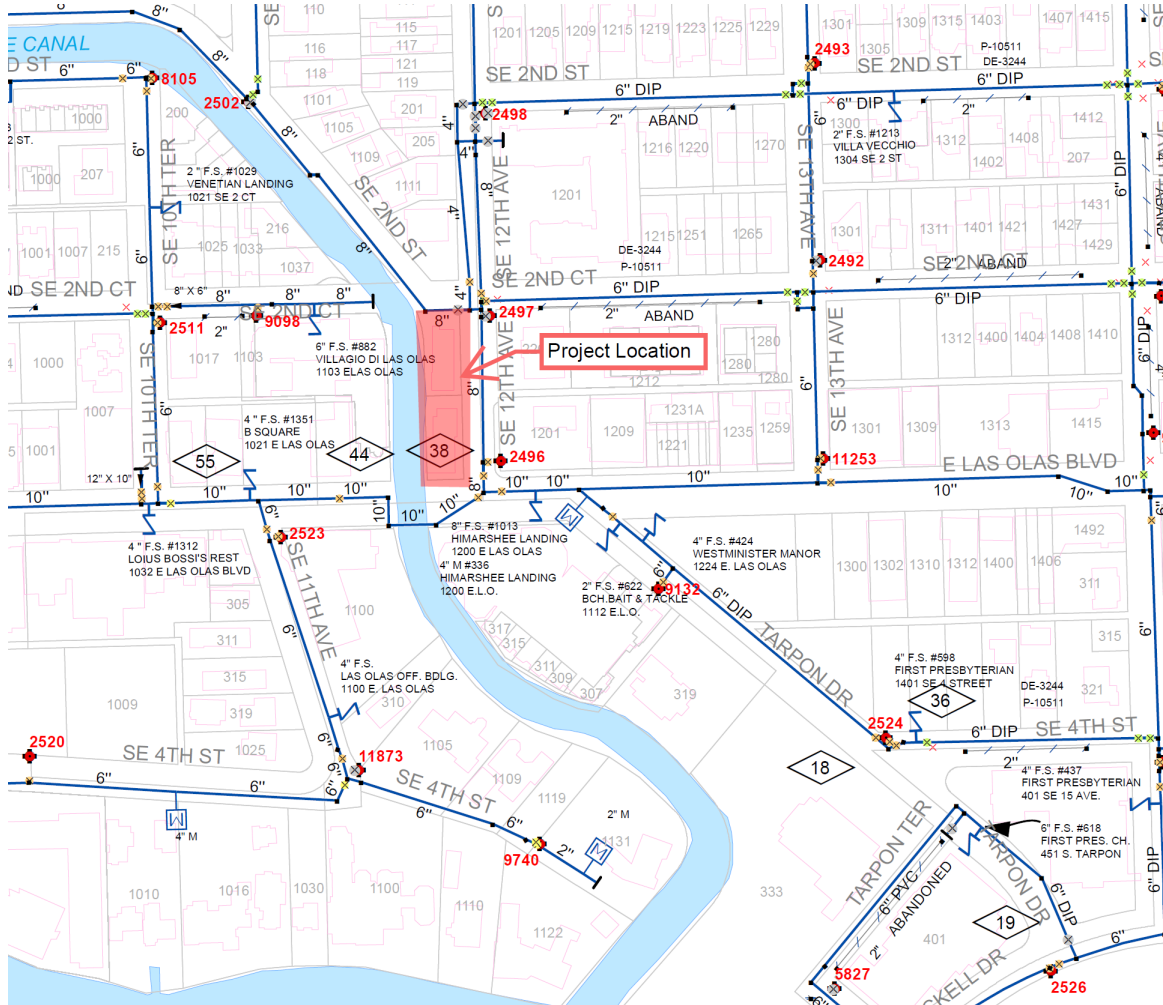

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301
TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV

Equal Opportunity Employer

CASE: UDP-SR25001
Exhibit 6
Page 5 of 9


Printed On Recycled Paper.



CAM #26-0384
Exhibit 8
Page 5 of 9



Figure 2. City Sewer Atlas

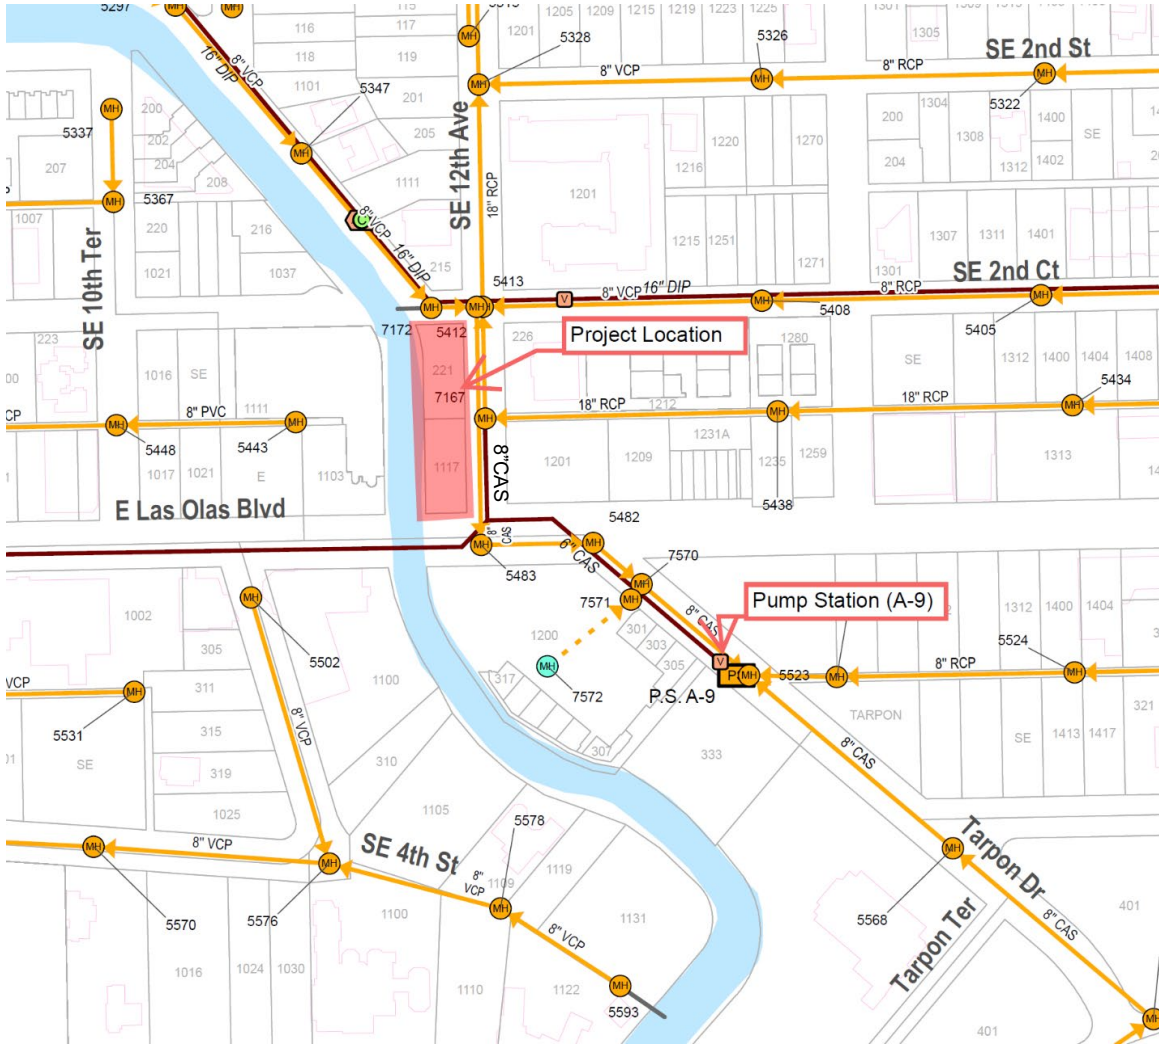

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301

TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV

Equal Opportunity Employer

CASE: UDP-SR25001

Exhibit 5

Page 6 of 9

Printed On Recycled Paper.



CAM #26-0384

Exhibit 8

Page 6 of 9



WATER CAPACITY ANALYSIS


Requested Demand: Based on the applicant’s site plan and building use information, the estimated average day potable water demand is approximately 0.0076 MGD. Average day water use demands are calculated by reducing the calculated max day water use demands by a factor of 1.18. The max day water use demands are calculated using the City’s Guidelines for the Calculations of Sanitary Sewer Connection Fees and are based on City Ordinance No. C-19-29.

Evaluation of impact on existing distribution system: According to the site plan, the applicant is proposing to utilize the 8-inch water main along SE 2 Court. The InfoWater hydraulic model was analyzed to determine the impact of the additional demand and fire flow requirements of this project on the water distribution system. The proposed water infrastructure has the capacity to support the proposed development.

Evaluation of impact of Permitted Water Plant Capacity: The Fiveash and the Peele Dixie Water Treatment Plants are designed to treat 70 MGD and 12 MGD of raw water respectively (82 MGD total). The total permitted Biscayne aquifer water withdrawals for these plants is limited to 52.55 MGD per the South Florida Water Management District (SFWMD) permit number 06-00123-W.

The current twelve-month rolling average production at the two plants is 38.36 MGD. The previously committed demand from development projects in the permitting or the construction stage is 5.73 MGD. Combining these figures with the demand from the proposed project of 0.0076 MGD, the required production would be 44.10 MGD. This is less than the allowable withdrawal limit of 52.55 MGD. Therefore, the water plants have sufficient capacity to serve this project. See Figure 3 below.

Figure 3. Water Treatment Capacity

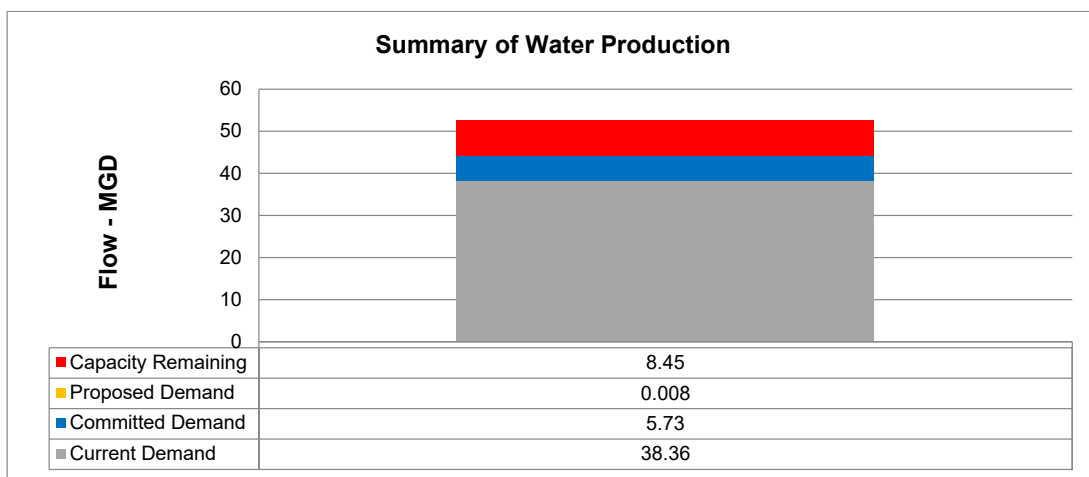

Recommended Water Infrastructure Improvements: No improvements required.

PUBLIC WORKS DEPARTMENT

100 N. ANDREWS AVE, FORT LAUDERDALE, FLORIDA 33301

TELEPHONE (954) 828-5772, FAX (954) 828-5074

WWW.FORTLAUDERDALE.GOV






WASTEWATER CAPACITY ANALYSIS

Requested Demand: Based on the applicant’s site plan and building use information, the estimated average day sewer use demand is approximately 0.0053 MGD. Average day sewer use demands are calculated using the City’s Guidelines for the Calculations of Sanitary Sewer Connection Fees and are based on City Ordinance No. C-19-29.

Evaluation of impact on existing collection system: According to the site plan, the applicant is proposing to utilize the 8-inch gravity sewer main to the east of the project site along SE 12 Avenue. Accounting for existing flows and based on the tools and information available to the City staff, it has been calculated that the pipes downstream of the proposed development will flow less than the City’s governance plan threshold of 70% during peak flows. The pipes downstream of the developments are adequate to serve the project.

Evaluation of impact on pumping station: PS A-9 has a duty point of 350 gallons per minute (GPM) and has a Nominal Average Pump Operating Time (NAPOT) of approximately 3.73 hours per day. Based on projected sewage flows, the pumping run times would increase approximately 15 minute per day. PS A-9 will have a NAPOT of 3.98 hours once the proposed developments are complete, less than the recommended average of 10 hours per day. See Figure 4 below.


Figure 4. Pump Station A-9 Nominal Average Pump Operating Time (NAPOT)

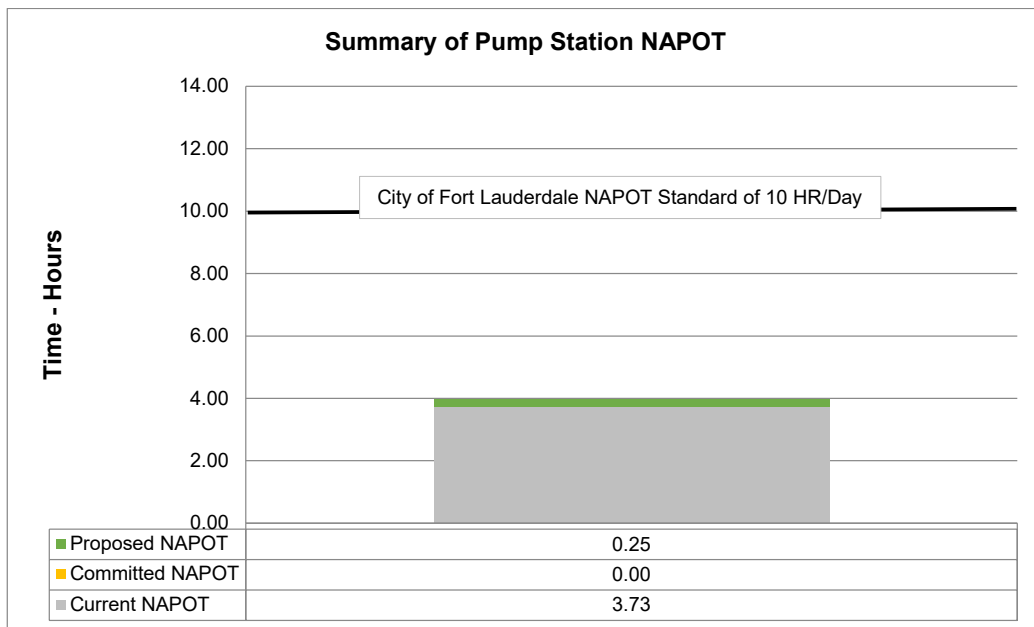



Evaluation of impact of Permitted Wastewater Plant Capacity: The City of Fort Lauderdale owns and operates the George T. Lohmeyer Regional Wastewater Treatment Plant (GTL), which provides wastewater treatment for the City of Fort Lauderdale. The Broward County’s Environmental Protection and Growth Management Department’s (EPGMD) Environmental Licensing & Building Permitting Division’s licensed capacity for GTL is 48 MGD-AADF (Million Gallons per Day – Annual Average Daily Flow). The annual average daily flow (AADF) to the plant is 39.97 MGD. Combining the committed flows for previously approved projects of 4.50 MGD plus the 0.0053 MGD net contribution from the project results in a total projected flow of 44.48 MGD. This is less than the permitted treatment plant capacity of 48 MGD. Therefore, the treatment plant has sufficient capacity to serve this project. See Figure 5 below.

Figure 5. Wastewater Treatment Capacity

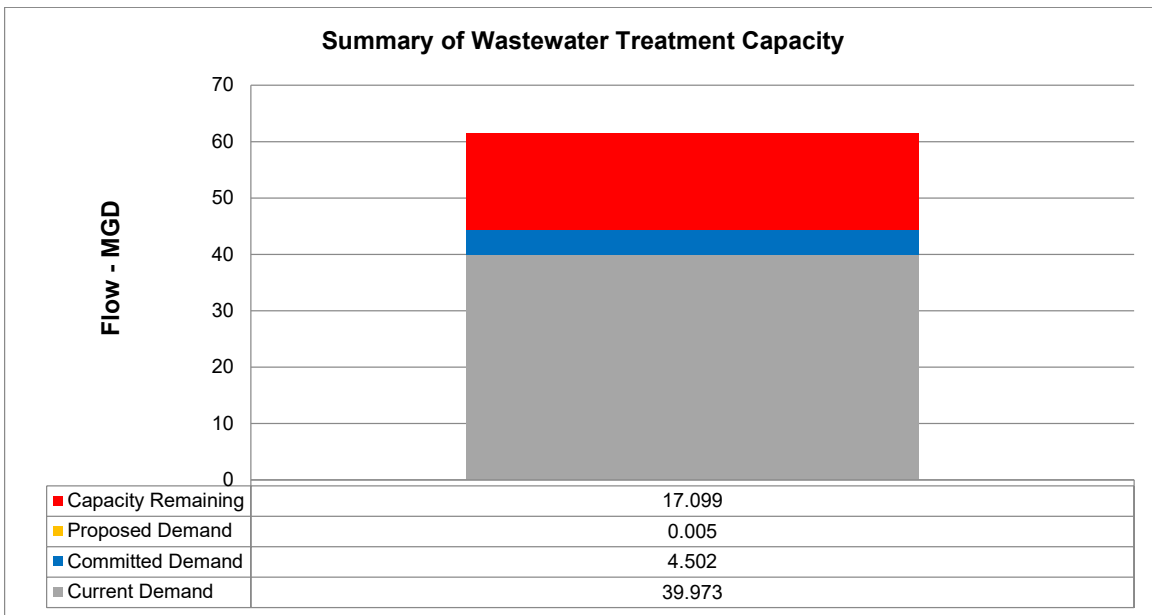

Recommended Wastewater Infrastructure Improvements: No improvements required.

